

### NOTES:

1. Fully encompass corporation stop with stone.
2. Meter box to be located on the right-of-way side of property line.
3. Meter and box to be furnished by the City. The City only installs the meter.
4. Fitting to be used when connecting to existing service, otherwise crimp end of service line.
5. Meter must be level across meter connections.



Department of Utilities  
10455 Armstrong Street  
Fairfax, VA 22030-3630

**CITY of FAIRFAX**  
USE WITH THE FAIRFAX STANDARD SPECIFICATIONS ONLY


Voice (703) 385-7920  
FAX (703) 934-8427  
www.fairfaxva.gov

## TYPICAL 1 1/2" & 2" WATER METER and SERVICE CONNECTION

SCALE: Not To Scale	DETAIL # 2515.02
REVISION DATE: April 2010	SHEET #: 1 of 2

PART	MANUFACTURER MODEL / Cat. No.
SADDLE	FORD / 101B AND 202B SERIES MUELLER / BR1B AND BR2B SERIES SMITH BLAIR / 321 AND 323 SERIES

## 1-1/2" and 2" Connection

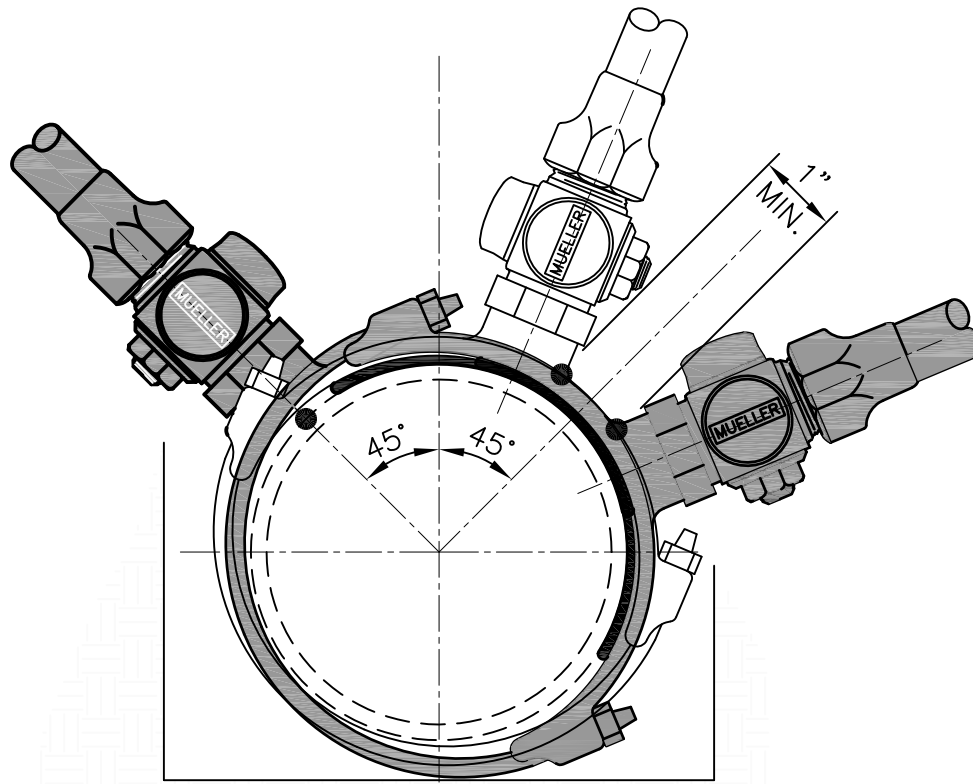

## SADDLE TAP

SCHEDULE – WATER METER BOX ASSEMBLY					
PIPE SIZE	METER SIZE	LAY LENGTH	BOX SIZE	BOX COVER #	EXTENSION RING #
1 1/2"	1 1/2"	13-1/4"	36" x 36"	FORD C-3 OR APPROVED EQUAL	FORD EXT-5 OR APPROVED EQUAL
2"	2"	17-1/4"	36" x 36"		



Department of Utilities  
10455 Armstrong Street  
Fairfax, VA 22030-3630

**CITY of FAIRFAX**  
USE WITH THE FAIRFAX STANDARD SPECIFICATIONS ONLY

Voice (703) 385-7920  
FAX (703) 934-8427  
[www.fairfaxva.gov](http://www.fairfaxva.gov)

## **TYPICAL 1 1/2" & 2" WATER METER and SERVICE CONNECTION**

SCALE:  
Not To Scale  
REVISION DATE:  
April 2010

DETAIL #  
2515.02  
SHEET #:  
2 of 2